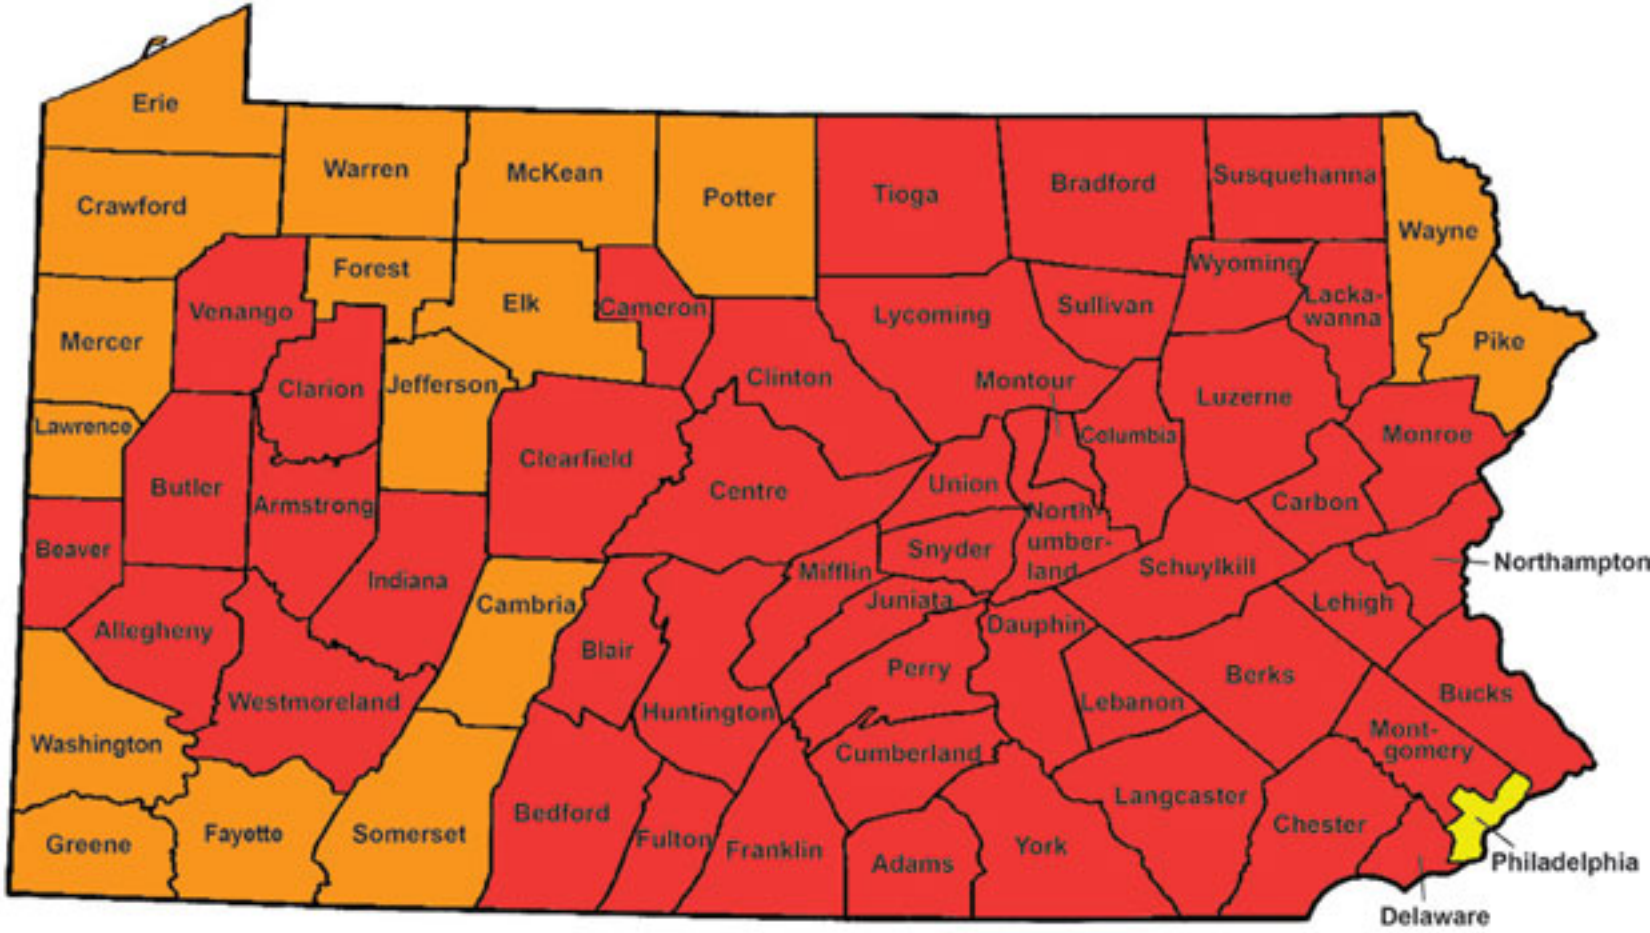

Zone 1 counties have a predicted average indoor radon screening level greater than 4 pCi/L (picocuries per liter) **(red zones)** — **Highest Potential**

Zone 2 counties have a predicted average indoor radon screening level between 2 and 4 pCi/L **(orange zones)** — **Moderate Potential**

Zone 3 counties have a predicted average indoor radon screening level less than 2 pCi/L **(yellow zones)** — **Low Potenial**